


# CLEARWATER POWER CO.

## TRENCH DETAIL

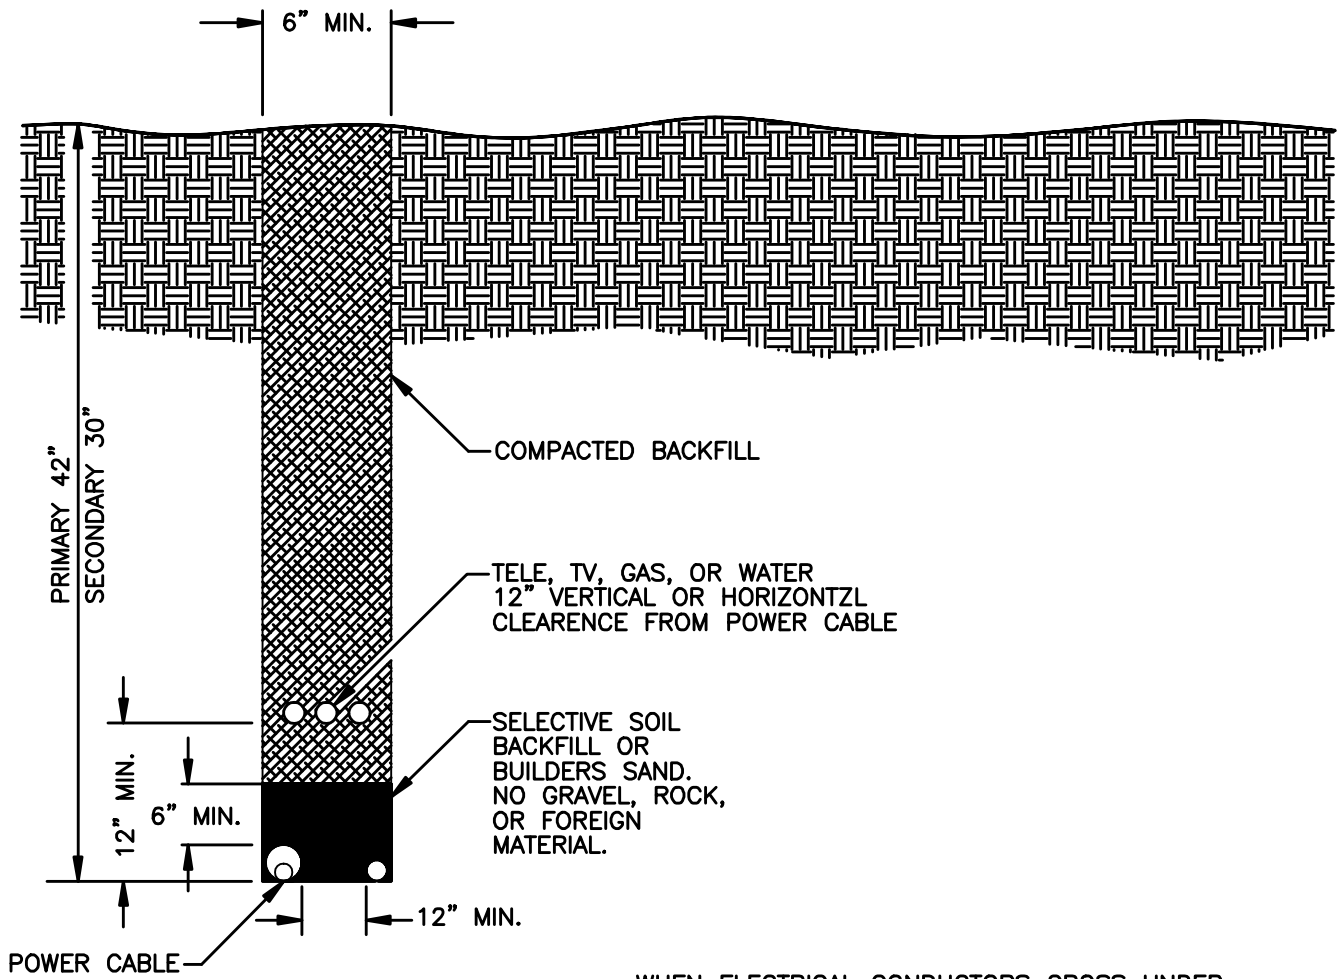

WHEN ELECTRICAL CONDUCTORS CROSS UNDER WATER, SEWER, AND/OR GAS PIPE, THERE SHALL BE A MINIMUM OF 12" OF VERTICAL CLEARANCE.