


**CLEARWATER POWER CO.**

TYPICAL U.G. PRIMARY AND SECONDARY  
DITCH DETAIL

1. MEMBER RESPONSIBLE FOR ALL TRENCHING, BACKFILLING, AND BEDDING.
2. ALL BACKFILL MUST BE COMPACTED BY MEMBER.
3. ANY ROAD XINGS MUST MEET STATE OR COUNTY SPECIFICATIONS AND USE A MINIMUM OF SCHEDULE 40 CONDUIT.

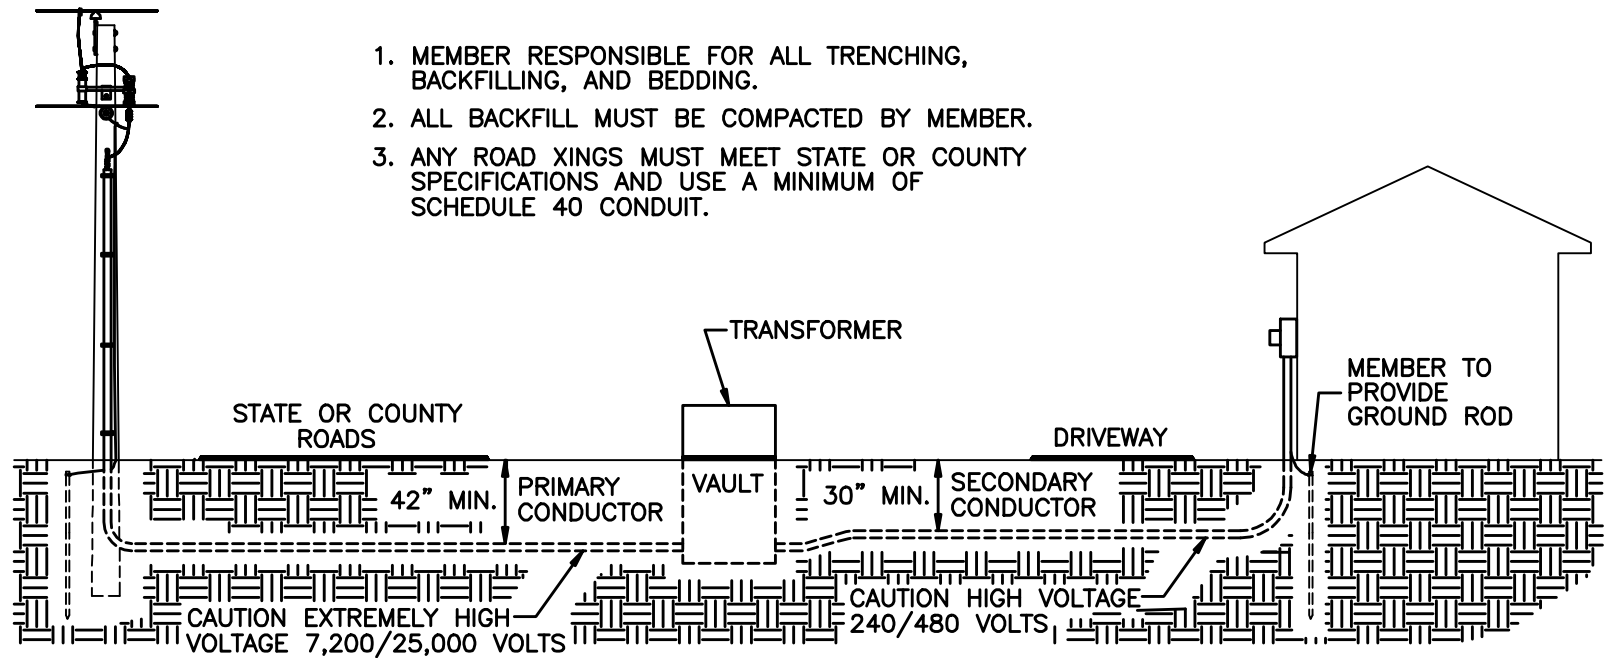

TOP VIEW

